ELECTRICAL PACKAGES

NO.	TAG	PACKAGE #	LOCATION	SWITCHES		ROOFTOP STARTERS	OPTION	FANS CONTROLLED				
				LOCATION	QUANTITY			TYPE	ø	H.P.	VOLT	FLA
1		11111002	Utility Cabinet Right	Utility Cabinet Right	1 Light		Exhaust in Fire	Exhaust	1	1.000	115	14.0
				Hood # 1	1 Fan							
								Supply	1	0.500	115	8.0
2		11111002	Utility Cabinet Left	Utility Cabinet Left	1 Light		Exhaust in Fire	Exhaust	1	1.000	115	14.0
				Hood # 2	1 Fan							
								Supply	1	0.500	115	8.0

ELECTRICAL PREWIRE PACKAGE	JOB NAME *Demeris BBQ #1359060*	DATE *6/7/2011*
DRAWING NUMBER *11111002*	JOB NUMBER *1359060*	DRAWN BY

CONTROL INPUT 120VAC H1=LINE, N1=NEUTRAL 15A BKR – DO NOT WIRE TO SHUNT TRIP BREAKER

120V/1Ph, W/ 1 Exhaust Fan, 1 Supply Fan, Exhaust in Fire

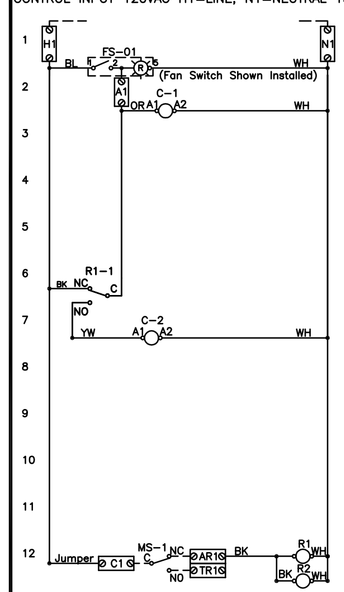

LIGHT INPUT 120VAC H2–H5=LINE, N2–N5=NEUTRAL 15A BKR (MAX 1400W PER CIRCUIT)

COMPONENT PARTS LIST

LABEL	DESCRIPTION
C-x	Contactor
ST-x	Starter
OL-x	Overload
FS-xx	Fan Switch (Lighted)
LS-xx	Light Switch
L	Hood Light(s)
MS-x	MicroSwitch (Ansul/PyroChem)
Rx	Relay DPDT – 34.110.0146.0 + Socket

SPARE FIRE DRY CONTACTS

SPARE RELAY CONTACTS USED WHEN FIRE SYSTEM DISCHARGES TO SHUT DOWN SHUNT TRIP, EQUIPMENT... OR PROVIDE SIGNALS.



Rx RELAY SOCKET STYLE



MOTOR	TAG	PH	VLT	HP	FLA	BRK
EXH-1		1	115	1	14	20A
SUP-2		1	115	0.5	8	15A

NOTES

– – – – DENOTES FIELD WIRING
——— DENOTES INTERNAL WIRING

WIRE COLOR

BK – BLACK YW – YELLOW
BL – BLUE GY – GRAY
BR – BROWN PR – PURPLE
OR – ORANGE OR/BK –ORANGE/BLUE (STRIPE)
RD – RED BL/RD – BLUE/RED (STRIPE)
WH – WHITE RD/GN – RED/GREEN (STRIPE)

DRAWING SHOWN DE–ENERGIZED

NOTE: IF WALL MOUNT PREWIRE, OR FIELD INSTALLED FIRE SYSTEM MICROSWITCH, THE TERMINALS SHOWING FACTORY WIRING MUST BE FIELD WIRED.

12 x 18 x 6 Box

ELECTRICAL PREWIRE PACKAGE	JOB NAME *Demeris BBQ #1359060*	DATE *6/7/2011*
DRAWING NUMBER *11111002*	JOB NUMBER *1359060*	DRAWN BY

CONTROL INPUT 120VAC H1=LINE, N1=NEUTRAL 15A BKR – DO NOT WIRE TO SHUNT TRIP BREAKER

120V/1Ph, W/ 1 Exhaust Fan, 1 Supply Fan, Exhaust in Fire

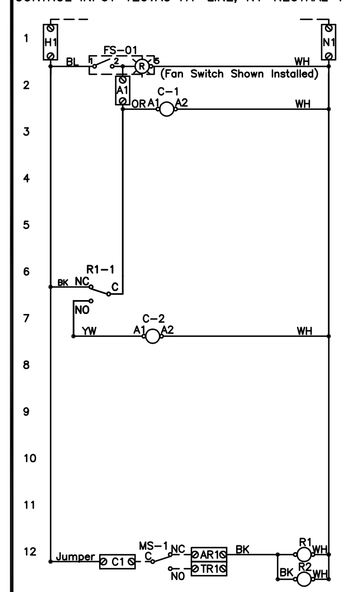

LIGHT INPUT 120VAC H2–H5=LINE, N2–N5=NEUTRAL 15A BKR (MAX 1400W PER CIRCUIT)

COMPONENT PARTS LIST

LABEL	DESCRIPTION
C-x	Contactor
ST-x	Starter
OL-x	Overload
FS-xx	Fan Switch (Lighted)
LS-xx	Light Switch
L	Hood Light(s)
MS-x	MicroSwitch (Ansul/PyroChem)
Rx	Relay DPDT – 34.110.0146.0 + Socket

SPARE FIRE DRY CONTACTS

SPARE RELAY CONTACTS USED WHEN FIRE SYSTEM DISCHARGES TO SHUT DOWN SHUNT TRIP, EQUIPMENT... OR PROVIDE SIGNALS.



Rx RELAY SOCKET STYLE



MOTOR	TAG	PH	VLT	HP	FLA	BRK
EXH-3		1	115	1	14	20A
SUP-4		1	115	0.5	8	15A

NOTES

– – – – DENOTES FIELD WIRING
——— DENOTES INTERNAL WIRING

WIRE COLOR

BK – BLACK YW – YELLOW
BL – BLUE GY – GRAY
BR – BROWN PR – PURPLE
OR – ORANGE OR/BL –ORANGE/BLUE (STRIPE)
RD – RED BL/RD – BLUE/RED (STRIPE)
WH – WHITE RD/GN – RED/GREEN (STRIPE)

DRAWING SHOWN DE–ENERGIZED

NOTE: IF WALL MOUNT PREWIRE, OR FIELD INSTALLED FIRE SYSTEM MICROSWITCH, THE TERMINALS SHOWING FACTORY WIRING MUST BE FIELD WIRED.

12 x 18 x 6 Box

CONTROL PANEL INSTALLATION	JOB NAME *Demeris BBQ #1359060*	DATE *6/7/2011*
DRAWING NUMBER *11111002*	JOB NUMBER *1359060*	DRAWN BY

HOOD TO CONTROL PANEL

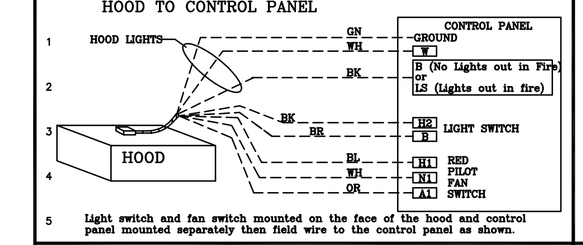

Light switch and fan switch mounted on the face of the hood and control panel mounted separately then field wire to the control panel as shown.

POWER FEED FOR CONTROLS AND LIGHTING

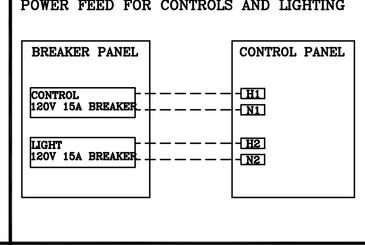

FIELD WIRED SWITCHES TO CONTROL PANEL

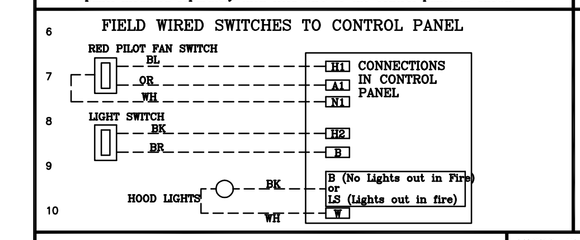

FIRE SYSTEM MICROSWITCH WIRING TO CONTROL PANEL

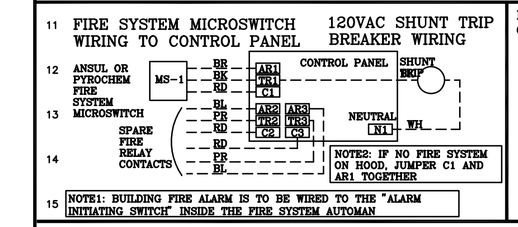

120VAC SHUNT TRIP BREAKER WIRING

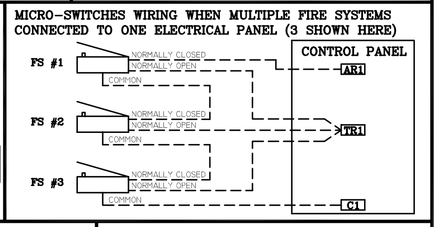

MICRO-SWITCHES WIRING WHEN MULTIPLE FIRE SYSTEMS CONNECTED TO ONE ELECTRICAL PANEL (3 SHOWN HERE)

FAN WIRING TO CONTROL PANEL

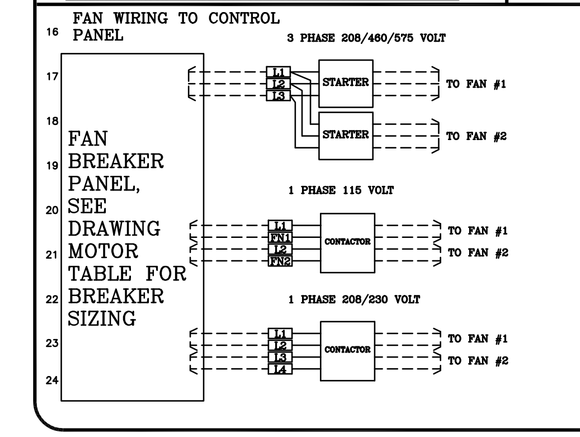

ELECTRIC GAS VALVE WITH RESET RELAY

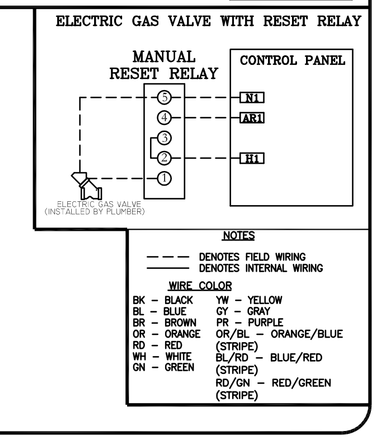

NOTES

– – – – DENOTES FIELD WIRING
——— DENOTES INTERNAL WIRING

WIRE COLOR

BK – BLACK YW – YELLOW
BL – BLUE GY – GRAY
BR – BROWN PR – PURPLE
OR – ORANGE OR/BL – ORANGE/BLUE (STRIPE)
RD – RED BL/RD – BLUE/RED (STRIPE)
WH – WHITE RD/GN – RED/GREEN (STRIPE)
GN – GREEN

1 HOOD DETAIL

REVISIONS

	DESCRIPTION	DATE:
1		
2		
3		
4		

CAPTIVEAIRE
HOUSTON OFFICE
www.captiveaire.com
2626 South Loop West, Suite 620, Houston, TX, 77054 PHONE: (713) 839-9945 FAX: (713) 839-9944 EMAIL: rep46@captiveaire.com

Demeris BBQ #1359060
HOUSTON, TX

DATE: 6/7/2011

DWG.#: 1359060

DRAWN BY: GAF

SCALE: 1/16

MASTER DRAWING

SHEET NO. 4

ISSUE	DATE	DESCRIPTION
	06/29/11	PERMIT / CONSTRUCTION
1	10/13/11	PERMIT / CONSTRUCTION
2	11/16/11	CITY COMMENTS

PROJECT:

CONSTRUCTION FOR
Demeris Barbecue

1702 West Loop North
Houston, Texas 77092

ENGINEER:



THIS SEAL WAS AUTHORIZED THIS DATE: 11/16/11

H.M. McLEOD, P.E.
4727 MERWIN ST. SUITE B
HOUSTON, TEXAS 77027
OFFICE: (713) 961-2090
FAX: (713) 961-5601
CELL: (713) 808-1646

Firm Registration:
H. M. McLeod, P.E. #F-3679

© 2011 H.M. McLeod, P.E.
Drawings, written material, and design concepts shall not be used or reproduced in whole or part in any form or format without prior written consent of H.M. McLeod, P.E.

DATE	6/17/11
PROJECT#	11141
SCALE	as noted
DRAWN BY	---

SHEET NAME:

HOOD DETAILS

SHEET NUMBER:

M-7